

DATA SHEET

Synchronous Alternator



Customer	:	Notes:
Customer reference	:	
Product line	: AG10-315MI30AI	Product code : 14419205
Area classification	: Safe	1010276444

General data Frame (IEC) : 315 Insulation Class : 180°C (H) THD (L-L, no load) : ≤ 3% Stator winding pitch : 2/3 Altitude : up to 1000 m.a.s.l Number of Leads : 12 Power factor : 0.8 to 1.0 Excitation system : Brushless with Auxiliary Coil Cooling : IC01	Degree of protection : IP23 Mounting style : B15T Number of poles : 4 Type of Pole : Salient Rated speed - 50 Hz : 1500 rpm Nominal rotation - 60 Hz : 1800 rpm Overspeed : 2250 rpm Approx. weight : 1516 kg Overload : 1.1x In per 1h each 6h Momentary Overload : 1.5x In per 30s
--	---



Frequency and number of phases				50 Hz						60 Hz											
				3ph						1ph		3ph								1ph	
Voltages (V)	Y (series star) connection			380	400	415	-		380	416	440	480	-								
	YY (parallel star) connection			190	200	208	-		190	208	220	240	-								
	Δ (series delta) connection			220	230	239	-		220	240	254	277	-								
	ΔΔ (parallel delta) connection			110	115	120	-		110	120	127	138	-								
	Zig-zag or single phase delta			-	-	-	190 - 200		-	-	-	-	220 - 240								
Output power (kVA)	Continuous 80/40			600	600	522	346		608	649	672	740	388								
	Continuous 105/40			687	687	598	397		710	743	770	850	445								
	Continuous 125/40			750	750	653	433		760	811	840	925	485								
	Standby 150/40			822	822	715	474		810	876	920	1010	531								
	Standby 163/27			856	856	745	495		868	926	958	1056	553								
Electrical data (FP=0.8 / Continuous 125/40 (H)) Saturated reactances values	Xd(%) Dir. axis synchronous reactance			132.9	106.9	93.0	177.2		266.9	264.8	247.6	133.61	330.2								
	X'd(%) Dir. axis transient reactance			13.2	11.6	10.1	17.6		22.7	18.4	17.2	14.9	22.9								
	X''d(%) Dir. axis subtrans. reactance			9.7	8.3	7.2	12.9		16.8	13.4	12.5	10.67	16.7								
	Xq(%) Quad. axis sync. reactance			43.5	32.7	28.4	58.0		126.5	95.4	61.2	50.37	81.6								
	X''q(%) Quad. axis subtrans. react.			7.8	8.3	7.2	10.3		15.7	23.0	9.5	9.79	12.6								
	X2(%) Negative sequence reactance			8.7	8.3	7.2	11.6		16.2	18.2	11.0	10.23	14.6								
	X0(%) Zero sequence reactance			1.6	1.4	1.2	2.1		2.8	2.2	2.1	1.78	2.8								
	T'd(ms) Short Circ.Trans.time const.			136.2	131.1	131.1	181.6		180.1	73.4	171.7	157.27	228.9								
	T''d(ms) Short Circ. Sub. time const.			0.6	0.4	0.4	0.8		1.4	1.5	0.8	0.48	1.1								
	T'do(ms) Open Circ. time const Trans			1386	1225	1225	1847		2142	968	1826	1471.09	2435								
	T''do(ms) Open Circ. time const Subt			1.6	1.5	1.5	2.1		2.1	1.9	2.0	1.8	2.6								
	Ta(ms) Armature time const.			12	10	10	15		20	14	15	13.08	20								
	uc(V) Full load excitation voltage			70.0	68.0	68.0	70.0		67.0	67.3	65.0	70.0	65.0								
	ic(A) Full load excitation current			3.5	3.4	3.4	3.5		2.8	3.3	3.1	3.5	3.1								
	ic(A) No load excitation current			1.1	0.9	0.9	1.5		0.5	1.0	0.9	1.4	1.2								
	Icc(A) Sustained Short-Circ. Current			3419	3248	2725	3248		3464	3359	3307	3337.81	3031								
	Kcc Short-circuit ratio			0.5	0.63	1.08	0.67		0.42	0.51	0.58	0.76	0.77								
Efficiency (%)	Power factor			0.8	1.0	0.8	1.0	0.8	1.0	0.8	1.0	0.8	1.0	0.8	1.0	0.8	1.0				
	25% of load			90.3	92.4	89.5	91.8	89.5	91.8	83.1	85	91.9	93.6	91.3	93.2	91	92.9	90.4	92.5	83.7	85.4
	50% of load			93.6	95.2	93.2	94.9	93.2	95	86.1	87.6	94.6	95.9	94.3	95.7	94.1	95.6	93.9	95.4	86.6	88
	75% of load			94.3	95.9	94.1	95.7	94.1	95.8	86.8	88.2	95.1	96.3	94.9	96.3	94.6	96.3	94.7	96.2	87	88.6
	100% of load			94.4	96	94.2	96	94.2	96	86.8	88.3	95	96.3	95	96.4	95.1	96.4	94.9	96.4	87.5	88.7
	125% of load			94.1	95.9	94	95.9	94	96	86.6	88.2	94.7	96.1	94.8	96.2	94.9	96.4	94.7	96.4	87.3	88.7

Other characteristics Air flow : 2.79 m³/s Exciter stator winding resistance at 20°C : 15.26 ohm Stator winding resistance at 20°C : 0.00295 ohm Rotor winding resistance : 2.1 ohm Stator winding layers : 2 Inertia WR² : 7.94 kgm² NDE Bearing : 6316 2RS DE bearing : Flange : SAE 0 Coupling disc : SAE 14	Automatic voltage regulator Accuracy (stability) : +/- 0.5% Rated current : 5 A Analog input : Yes Digital input : No Peak current : 7 A/10 s Droop / TC : Yes Dynamic recovery : 8 to 500 ms U/F : Yes Internal voltage adjustment : +/- 15% External voltage adjustment : +/- 10% Transient recovery time for ΔU=20% : 500 ms	According to: IEC 60034 NBR 5117 NEMA MG1 VDE530 ISO 8528 CSA
--	---	--

Rev.	Changes Summary	Performed	Checked	Date
Performed by				Page
Checked by				Revision
Date				1 / 6

DATA SHEET

Synchronous Alternator

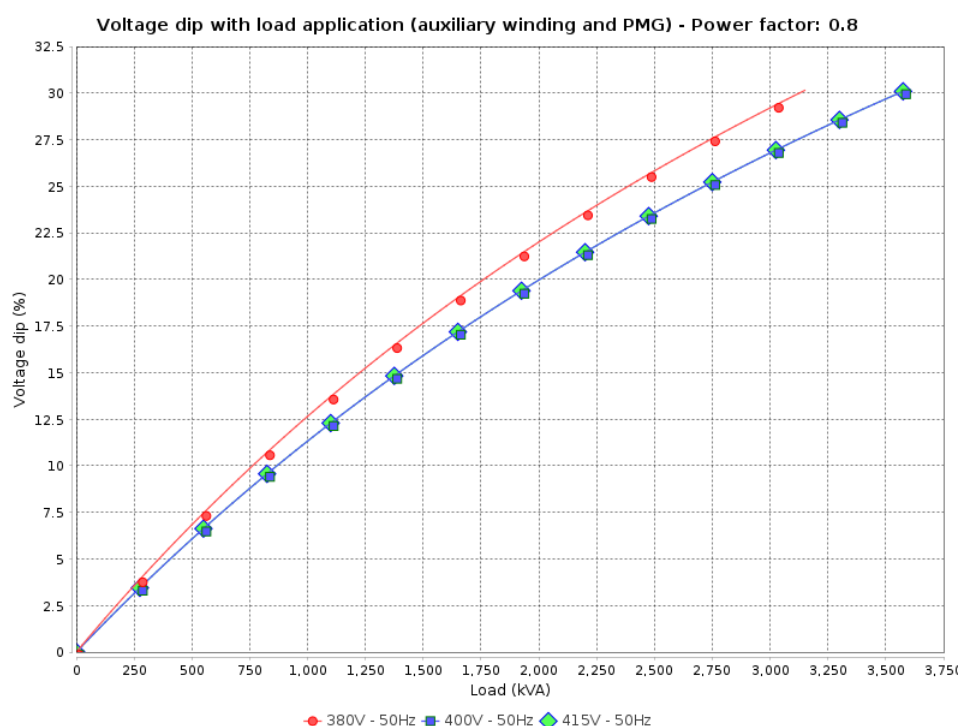
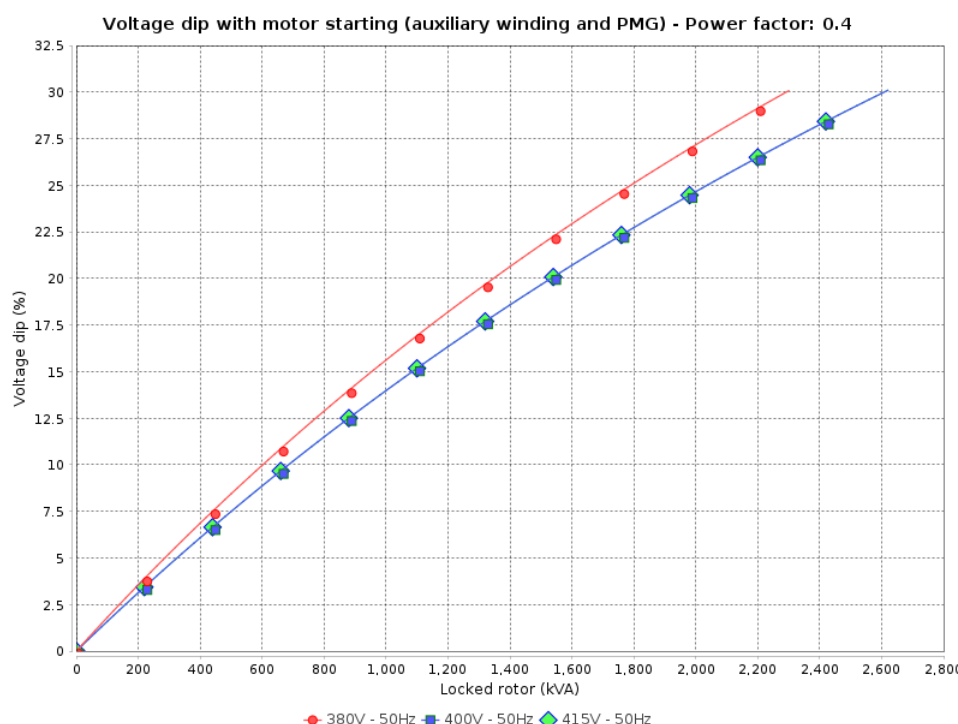


Rev.	Changes Summary		Performed	Checked	Date
Performed by				Page 2 / 6	Revision
Checked by					
Date					
	08/06/2023				

This document is exclusive property of WEG S/A. Reprinting is not allowed without written authorization of WEG S/A. The indicated values are typical values and subject to change without prior notice.

DATA SHEET

Synchronous Alternator

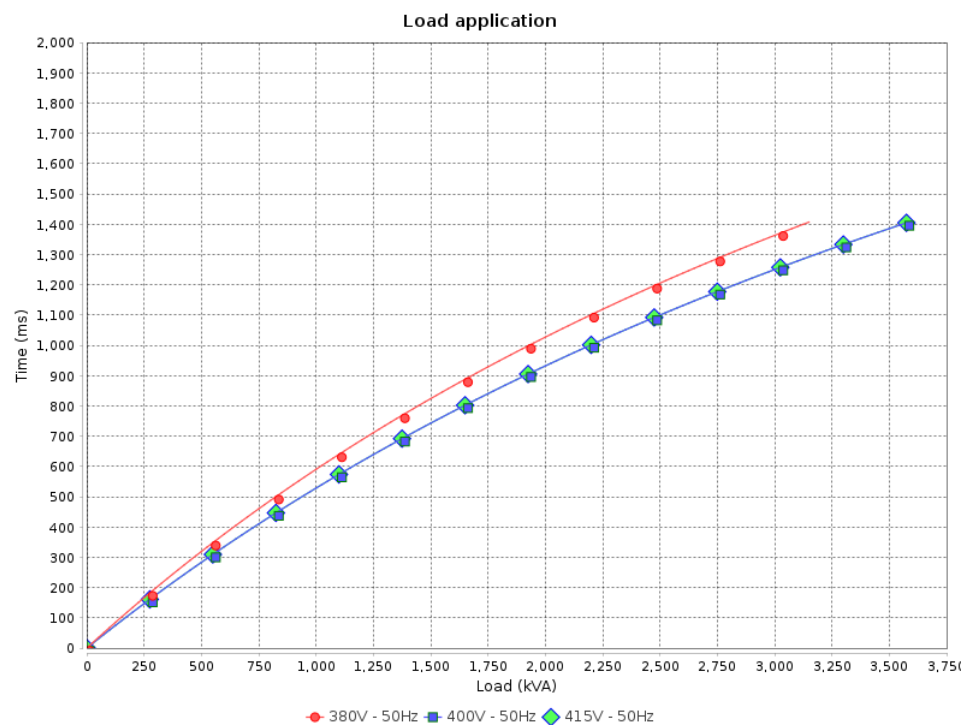
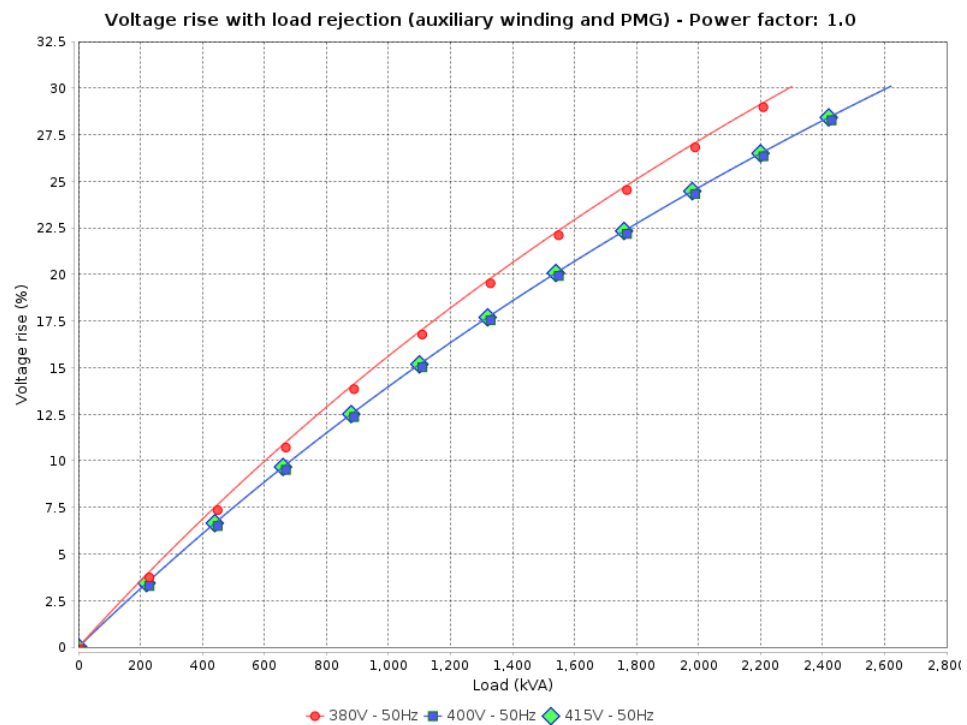


Rev.	Changes Summary		Performed	Checked	Date
Performed by				Page 3 / 6	Revision
Checked by					
Date	08/06/2023				

This document is exclusive property of WEG S/A. Reprinting is not allowed without written authorization of WEG S/A. The indicated values are typical values and subject to change without prior notice.

DATA SHEET

Synchronous Alternator

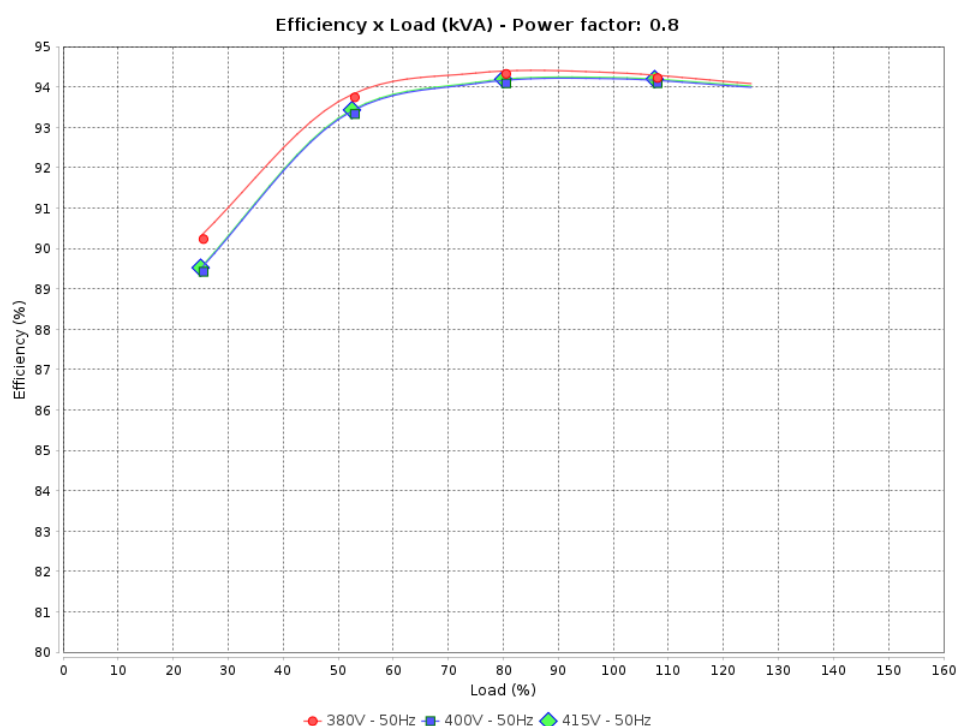
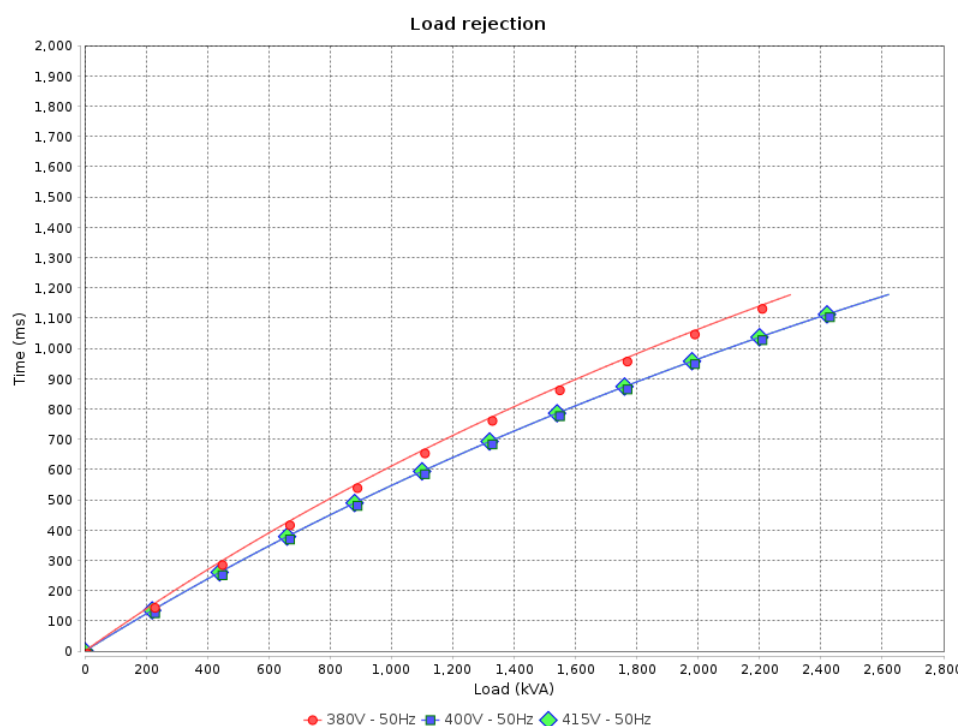


Rev.	Changes Summary		Performed	Checked	Date
Performed by				Page 4 / 6	Revision
Checked by					
Date	08/06/2023				

This document is exclusive property of WEG S/A. Reprinting is not allowed without written authorization of WEG S/A. The indicated values are typical values and subject to change without prior notice.

DATA SHEET

Synchronous Alternator

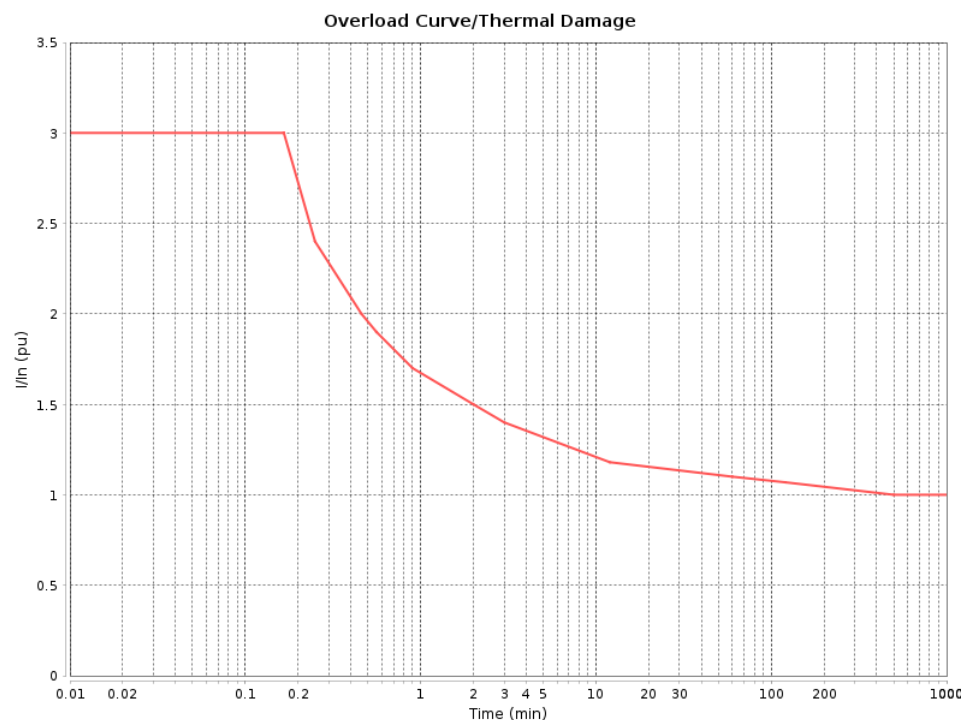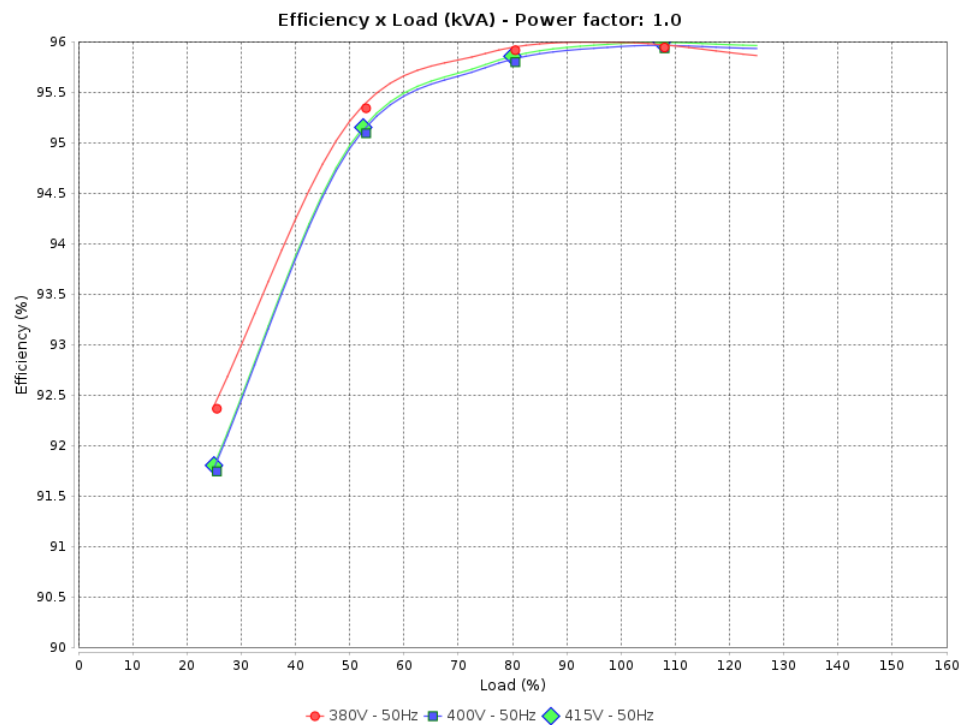


Rev.	Changes Summary		Performed	Checked	Date
Performed by				Page 5 / 6	Revision
Checked by					
Date	08/06/2023				

This document is exclusive property of WEG S/A. Reprinting is not allowed without written authorization of WEG S/A. The indicated values are typical values and subject to change without prior notice.

DATA SHEET

Synchronous Alternator

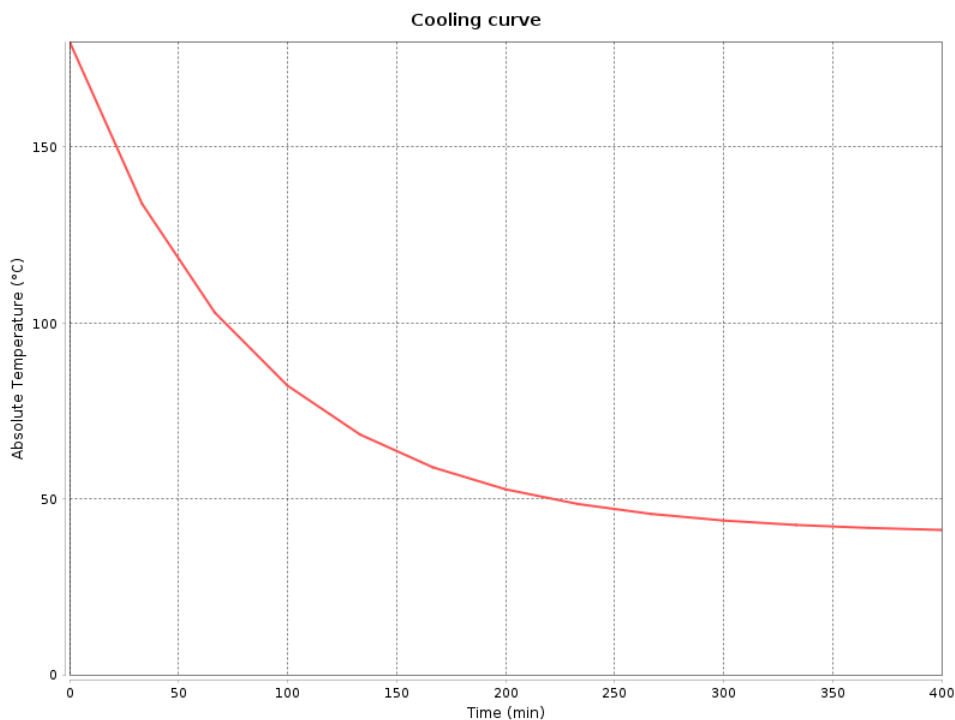

Rev.	Changes Summary		Performed	Checked	Date
Performed by			Page 6 / 6		Revision
Checked by					
Date	08/06/2023				